

DIP-34A-03**Analog Addressable Photoelectric
Smoke Detector**

INSTRUCTION MANUAL

**GENERAL**

DIP-34A-03 Analog Addressable Photoelectric Smoke Detector (hereinafter referred to as the DIP-34A-03 or the detector) is to be used in a fire alarm system. It is designed to detect fires which come with appearing of smoke within closed spaces.

The DIP-34A-03 operates under control of the S2000-KDL or S2000-KDL-2I controller which the detector is connected to and which supplies power and communicates data with the DIP-34A-03 via the two-wire multiplex addressable polling loop being a part of an Orion integrated security system. Up to 127 DIP-34A-03 detectors can operate under a single S2000-KDL or S2000-KDL-2I.

The DIP-34A-03 detects smoke inside its sensing chamber by sensing light reflected by smoke particles and responds with its state to the S2000M panel or Orion Pro software via the S2000-KDL or S2000-KDL-2I controller. Depending on detected smoke amount these states can be Norm, Fire Prealarm or Fire Alarm.

The detector meets the requirements of Appendix "P" of Russian Regulations СП5.13130.2009. In addition, the detector can respond to the console's request with a current condition of its sensing chamber which corresponds to its smoke or dust level. Based on this answer, an operator of the control panel can make a decision about maintenance works or waiting for a Fire Pre-alarm message in case of appearance of smoke at the beginning of a fire.

Electromagnetic compatibility of the detector meets the requirements of the third immunity level accordingly to Russian standards.

The DIP-34A-03 supports DPLS_v2.xx Multiplex Addressable Polling Loop Protocol enabling monitoring addressable loop voltage at the detector's location. The version of DIP-34A-03 firmware is 1.01.

Operability of the detector can be periodically tested by means of a laser test tool (such as the test tool produced by the System Sensor Company).

SPECIFICATIONS

Sensitivity	0.05 - 0.2 dB/m (1.2 %/m to 4.7 %/m)
Response Time	10 s max
Ingress Protection Rating	IP 41
Input Voltage (from an S2000-KDL(-2I))	8 ÷ 11 V dc
Current Consumption (via the loop of the S2000-KDL(-2I))	0.5 mA max
Pre-operation Time	60 s max
Operating Temperatures	-30 to +55°C
Storage Temperatures	-50 to +50°C
Humidity	Up to 93% at +40°C, non-condensing
Overall Dimensions (diameter x height)	100x47 mm max
Weight	0.2 kg max
Average Lifetime	At least 10 years
The content of precious materials	No need to account for storage, disposal and recycling (Clause 1.2 of Russian Standard ГОСТ 2.608-78)

STANDARD DELIVERY

For *single-piece* delivery:

- DIP-34A-03 Detector - 1 pc.
- Instruction Manual - 1 pc.
- Address Sticker - 1 pc.
- Protective Cover - 1 pc.
- Unit Package - 1 pc.

For *group* delivery:

- DIP-34A-03 Detector - 10 pcs.
- Instruction Manual - 1 pc.
- Address Sticker - 10 pcs.
- Protective Cover - 10 pcs.
- Group Package - 1 pc.

WIRING

Figure 1 shows the connection diagram for connecting a DIP-34A-03 detector to the addressable polling loop of an S2000-KDL or S2000-KDL-2I controller. The first terminal of the mounting base can be used to connect a cable screen.

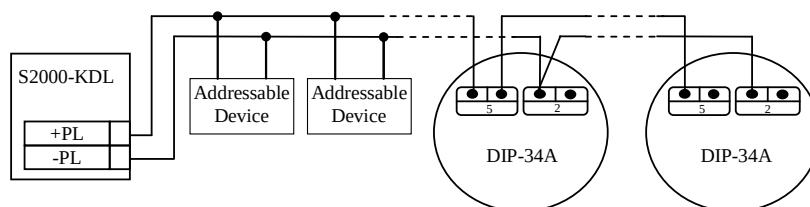


Figure 1. Connection Diagram

MOUNTING

When the detector is mounted on a ceiling, it is necessary to follow the requirements of Rules СП5.13130.2009, in particular Table 13.3:

Height	Average Area Monitored by a Single Detector	Distance	
		Between Detectors	Between a Detector and Wall
Below 3.5 m	Up to 85 sq.meters	9.0 meters	4.5 meters
3.5 ÷ 6 m	Up to 70 sq.meters	8.5 meters	4.0 meters
6 ÷ 10 m	Up to 65 sq.meters	8.0 meters	4.0 meters
10 ÷ 12 m	Up to 55 sq.meters	7.5 meters	3.5 meters

If cannot be installed on a ceiling, the DIP-34A-03 can be mounted on wire ropes as well as on a wall, a column, or any other structural. Installing point-type detectors on walls please follow the instructions of Appendix "П" of Rules СП5.13130.2009.

Figure 2 shows two possible ways of attaching the detector. To attach the detector to a solid surface (variant **A**) use the mounting base provided (see also the drilling pattern in Figure 3, at the left). Otherwise, a separately purchased mounting kit MK-2 can be used to build the detector into a suspended ceiling (variant **B**). The size of the mounting hole is shown in Figure 3, at the right.

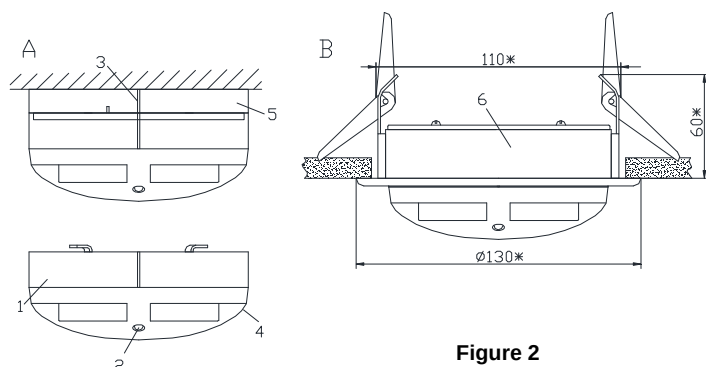


Figure 2

- 1: DIP-34A-03 Smoke Detector
- 2: LED Status Indicator
- 3: Matchmark
- 4: Triangular Arrow and Rectangular Hole (open here when maintaining)
- 5: Mounting Base
- 6: MK-2 Suspended Ceiling Mounting Kit (supplied separately)




Figure 3

Figure 3 shows the drilling pattern to install the detector for the variant A and the diameter of the mounting hole in the suspended ceiling for the variant B.

WARNING:

To attach the detector to the mounting base, place the detector into the base and rotate clockwise until the detector drops into place and the matchmark moulded in the detector lines up with the short mark on the mounting base. Continue rotating clockwise until the matchmark on the detector lines up with the matchmark 3 as shown in Figure 2 (A) and the detector locks into place.

PROGRAMMING

In order the DIP-34A-03 to operate properly within the two-wire addressable polling loop of the S2000-KDL or S2000-KDL-2I controller, it must be assigned to a unique number from 1 to 127 within the loop – to the address which is stored in the DIP-34A-03 non-volatile memory. This address provides identifying the detector by the controller. Moreover, a monitoring strategy must be defined which will be used by the controller while processing signals received from the DIP-34A-03.

Programming the DIP-34A-03 Address within the S2000-KDL/S2000-KDL-2I Addressable Loop

A DIP-34A-03 is supplied with the default address of 127. This address value can be changed using either S2000(M) panel tools or PC tools such as UProg Configuration Tool.

In order to program the unique DIP-34A-03 loop address connect the detector to a S2000-KDL/S2000-KDL-2I controller which in turns is connected to a network controller (a S2000(M) panel or PC under UProg software). Then send one of the following commands to the loop controller (for getting more information see the relevant User's Manual):

<i>Change the Device Address</i>	Use the <i>Change Device Address</i> command specifying the old detector address and the new detector address as the parameters (see more information in the referred Manuals). The network controller will display the messages about disconnecting the device with the old address and then detecting the device with newly programmed address.
<i>Program the Device Address</i>	If the device address is unknown or two devices have the same address then use the <i>Program Device Address</i> command specifying a required address as the parameter. Then within 5 min press the detector light emitter or send the laser test tool beam into it. The message about detecting the device with the newly assigned address shall be displayed by a network controller (S2000(M)) or UProg Configuration Tool.

After programming write the set address of the detector on the "Address" label and stick it on the detector base.

Programming the S2000-KDL/S2000-KDL-2I to Operate the DIP-34A-03

To handle signals from a DIP-34A-03 correctly, an S2000-KDL/S2000-KDL-2I controller must be programmed with the *Zone Type* parameter for this DIP-34A-03 being set to the value 1 (*Smoke*) or 8 (*Smoke Analogue Addressable with Variable Thresholds*). To program the S2000-KDL/S2000-KDL-2I, connect it to a PC under UProg Configuration Tool and follow the relevant programming instructions in accordance with the S2000-KDL/S2000-KDL-2I User's Manual.

ROUTINE TESTING

Before testing the DIP-34A-03, please disconnect executive outputs of all system devices and modules that can release an extinguishing agent. Notify the proper authorities that the system is undergoing maintenance.



After testing verify that all the detectors are ready to operate properly. Then restore operability of all the system components disconnected before testing and notify the proper authorities that the system is back in operation.

All the equipment used in testing must be known functioning.

If the detector has failed please replace it for a healthy one and contact Technical Support. The defective detector should be repaired by the manufacturer of in a certified repair center.

1. Turn on the network controller and the S2000-KDL controller. The light emitter of the detector shall light steady. When the communications between the detector and S2000-KDL is established the light emitter will flash once per 4 seconds indicating Norm status of the detector.
2. Take a can of test aerosol and spray some of the test material into the detector. The network controller shall display *Fire Alarm* message for the device with the address of the DIP-34A-03. The detector's LED shall flash twice every 4 s.
3. Alternately, you can perform a simplified test by pressing the detector light emitter or lighting it with the laser beam of a laser test tool. This will cause solid lighting of the detector light emitter for 3 s followed by its double flashing every 4 s.
4. The network controller will display a:
 - *Fire Alarm* message for the device with the address of the DIP-34A-03 if the version of the S2000-KDL in use is 1.35 or below, or
 - *Test* message or *Fire Alarm* message (depending on the current test mode) when the version of the S2000-KDL in use is 1.36 or higher (see the Manuals for the S2000-KDL controller and the network controller for more information about testing)
5. When the test aerosol disappears (or light emitter is released, or laser test tool is disposed) the detector must be in the Norm status. If the S2000M console or Orion Pro software has displayed no messages mentioned above or the detector's LED performs in a different way than mentioned above then the detector is unhealthy and must be replaced.

LED INDICATION

Flashing once per 4 s	Norm
Four-time flashing once per 4 s	Programming an address
Double flashing once per 4 s	Fire Alarm or Test
Solid light	Waiting for establishing a connection with the S2000-KDL
	Pushing the LED or applying the laser test tool beam to the LED
Other	Trouble

MAINTENANCE

At least annually inspect the screen assembly under the detector cover. If there is any dust on the screen assembly, clean this one with a vacuum cleaner (by pumping air).

When a *Service Required* message is received from the detector, remove the dust from the sensing chamber.

In accordance with your rules of maintenance, maintain the detector as part of your fire alarm system.

WARNINGS



To avoid contamination of the detector, please DO NOT remove the protective cover until the surrounding area is cleared from dirt and dust.

DO NOT remove the detector's PCB because this automatically cancels the warranty.

DO NOT mount the detector within the premises where air velocity values exceed 15 m/s.

WARRANTY

The average lifetime of the detector is at least 10 years.

The manufacturer warrants its product to be free from defects in materials and workmanship under normal use and service for 18 months since putting it into operation, but no more than 24 months since the acceptance date.

While forwarding the product for repair please apply a report describing the potential failure.

Forward your claims to the address:

ZAO NVP Bolid, 4 Pionerskaya Str., Korolev 141070, Moscow Region, Russia

Phone/fax: **+7 495 775-7155** (PBX)

E-mail: info@bolid.ru,

Technical Support: support@bolid.ru,

<http://bolid.ru>

CONFORMITY CERTIFICATES

DIP-34A-03 Analog Addressable Photoelectric Smoke Detector is approved by Conformity Certificate № C-RU.4C13.B.00149.

Conformity Certificate TC № RU Д-RU.ME61.B.00312 certifies that DIP-34A-03 Analog Addressable Photoelectric Smoke Detector meets the requirements of Technical Regulations of Custom Union TR CU 020/2011.

DIP-34A-03 is a part of Orion Addressable Fire Alarm System which is approved by Conformity Certificate № BY/112 02.01.033 00573.

Production of DIP-34A-03 Analog Addressable Photoelectric Smoke Detector is certified in line with Russian Standard GOST ISO 9001 – 2011 by a Conformity Certificate № POCC RU.ИК32.K00153.

PRODUCT ACCEPTANCE CERTIFICATE

DIP-34A-03 analog addressable photoelectric smoke detectors (the serial numbers are specified on the cases of the detectors and written into the memory of their microprocessors) are qualified as proper for operation and packaged by CJSC NVP "Bolid".

Responsible for acceptance and packaging



QCD

Full Name

Date, Month, Year